

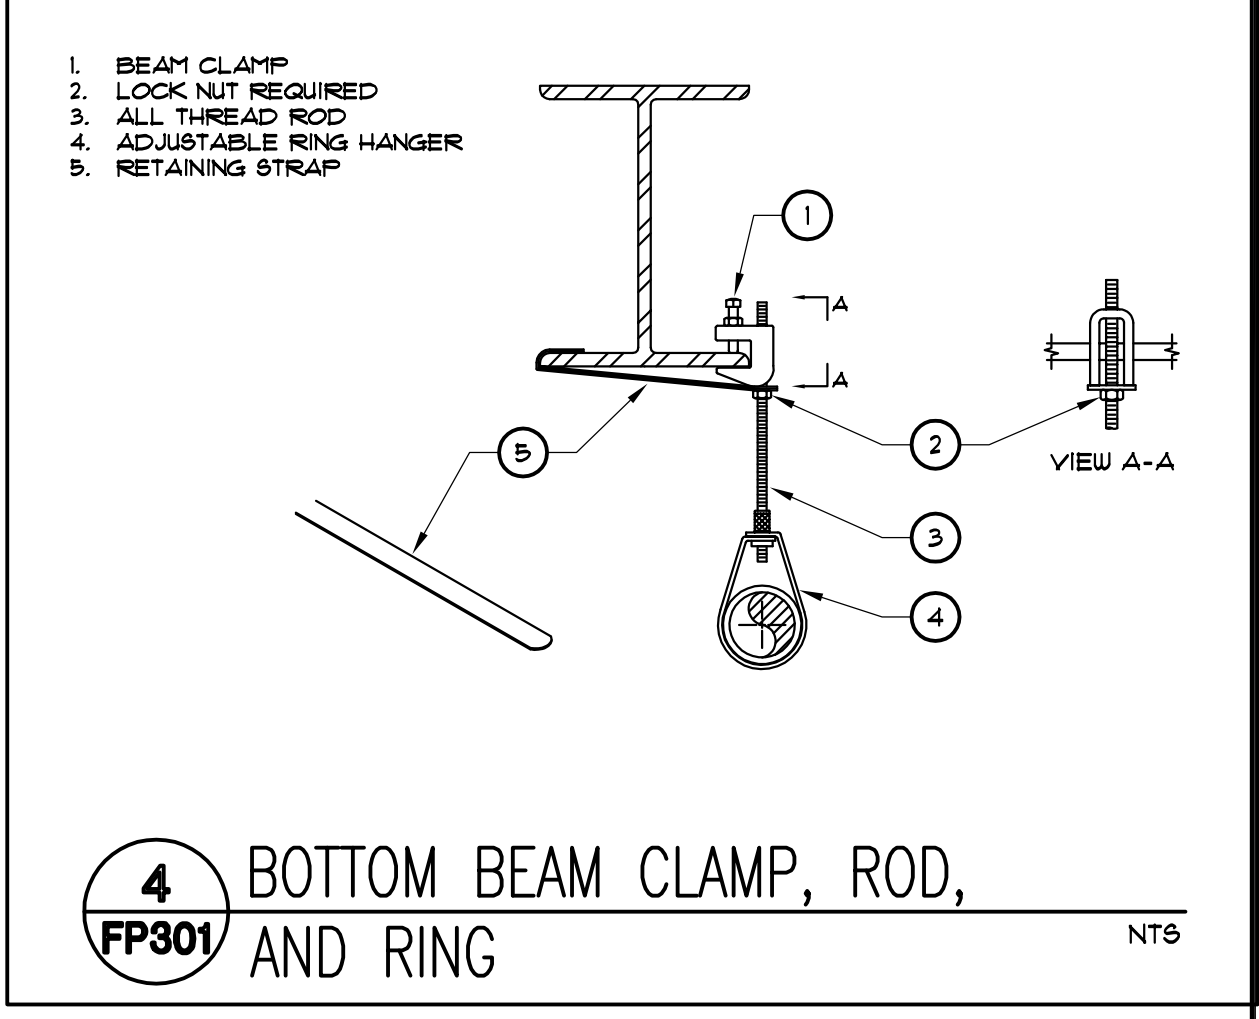
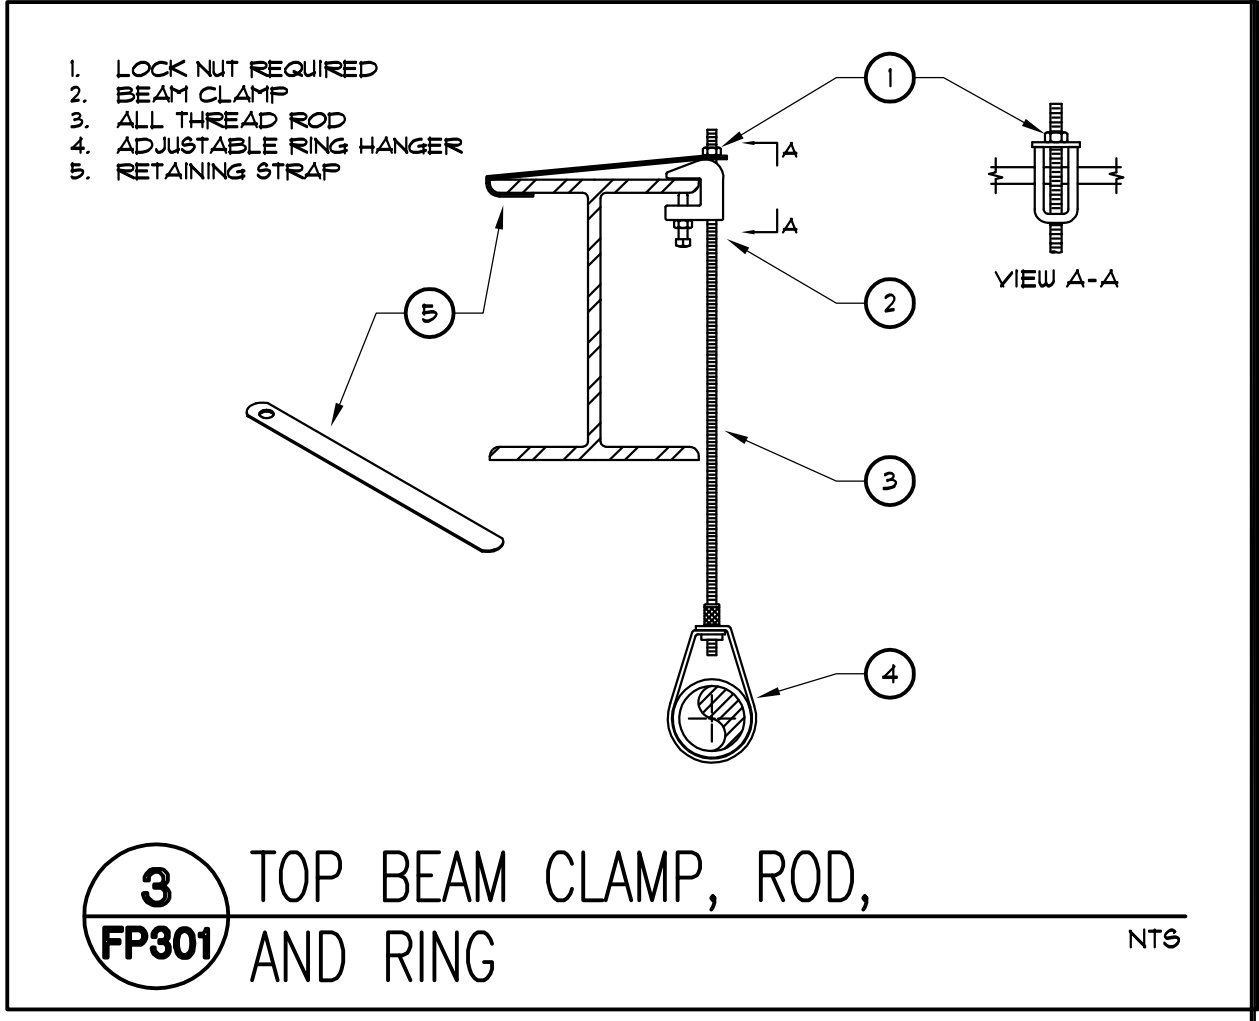
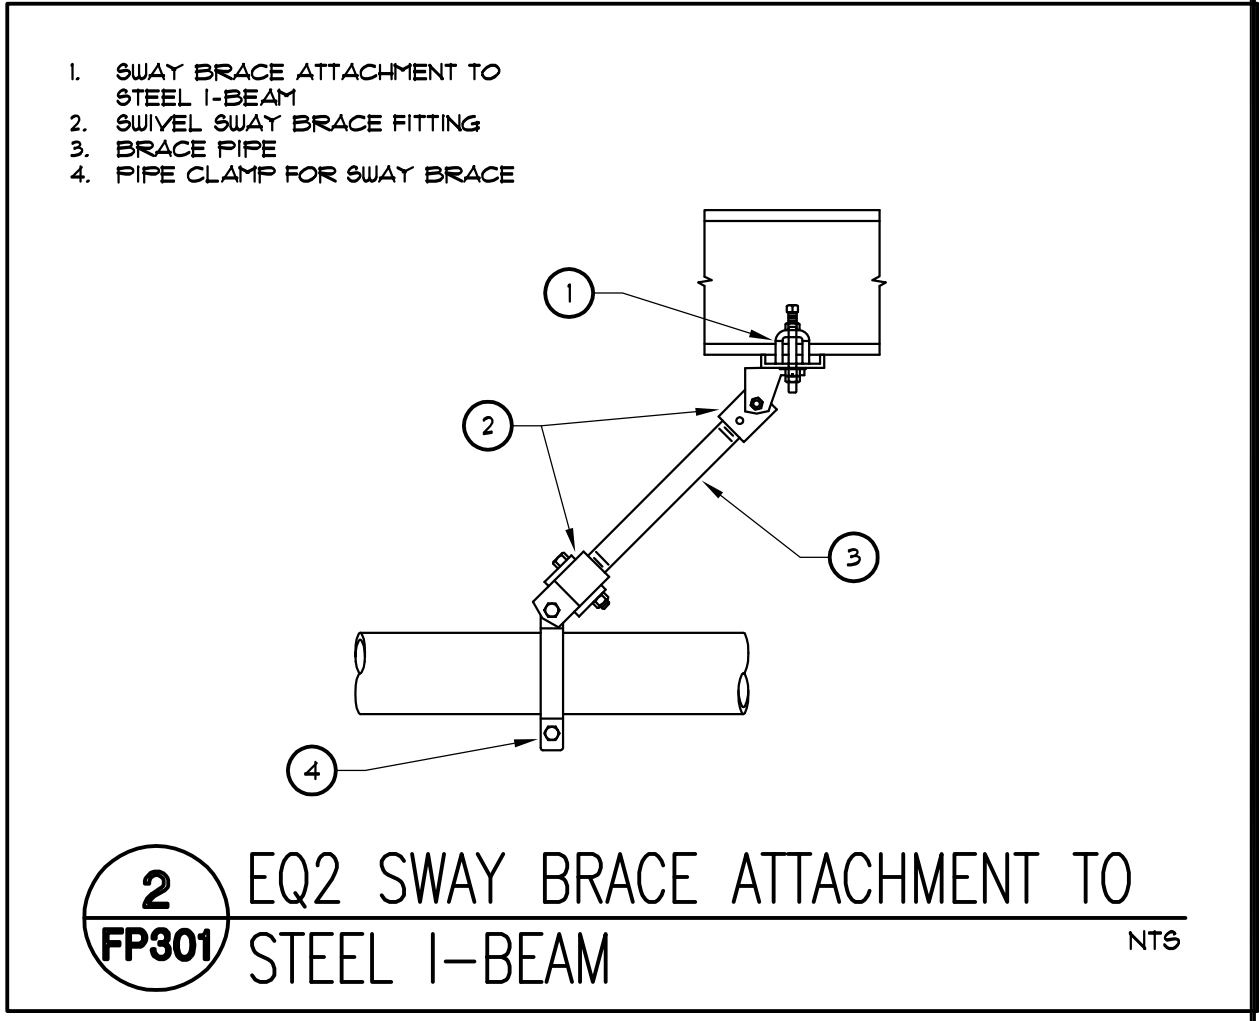
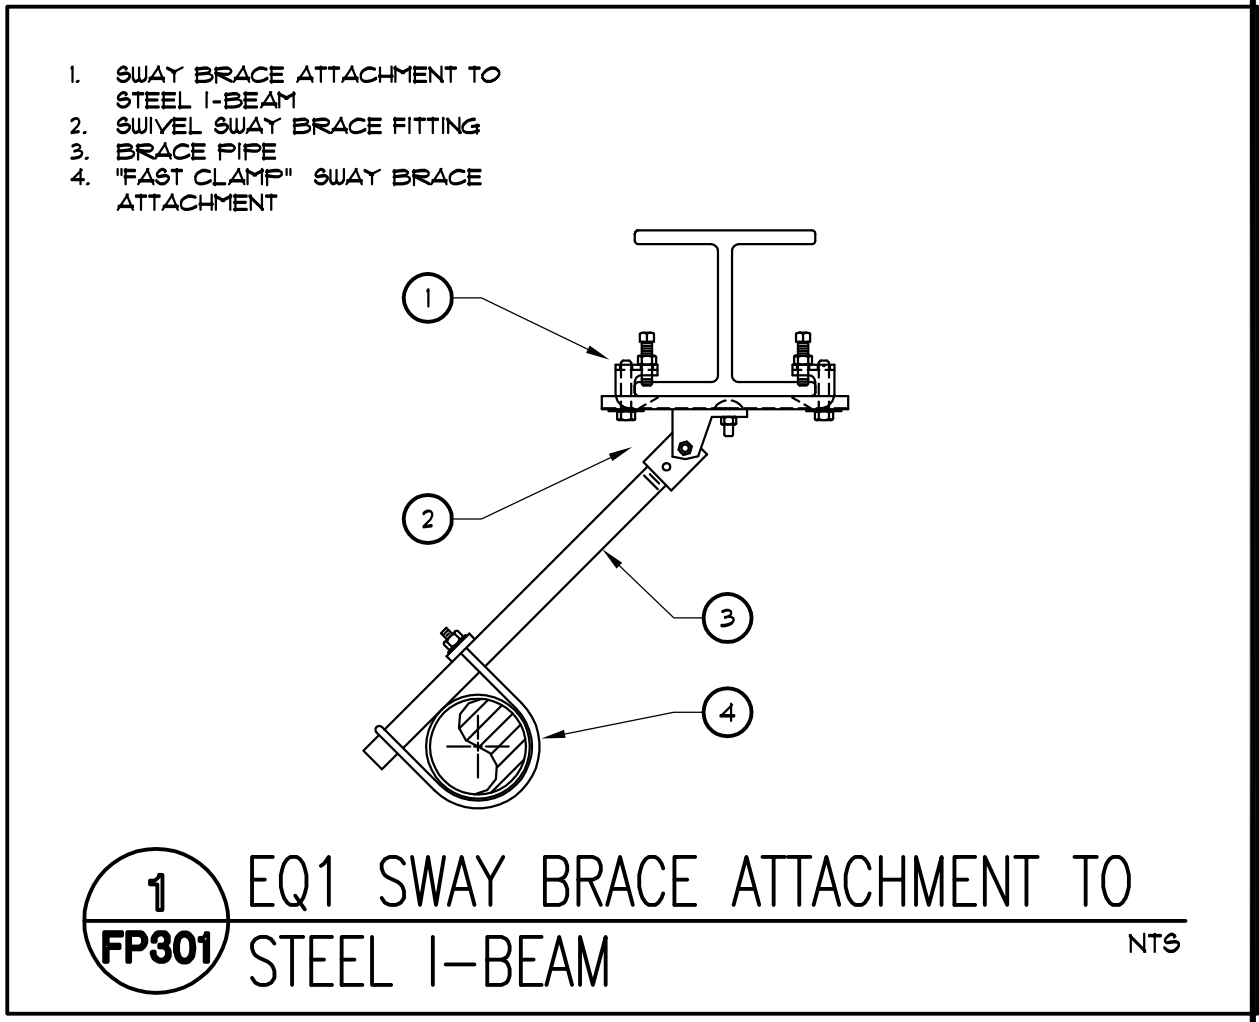
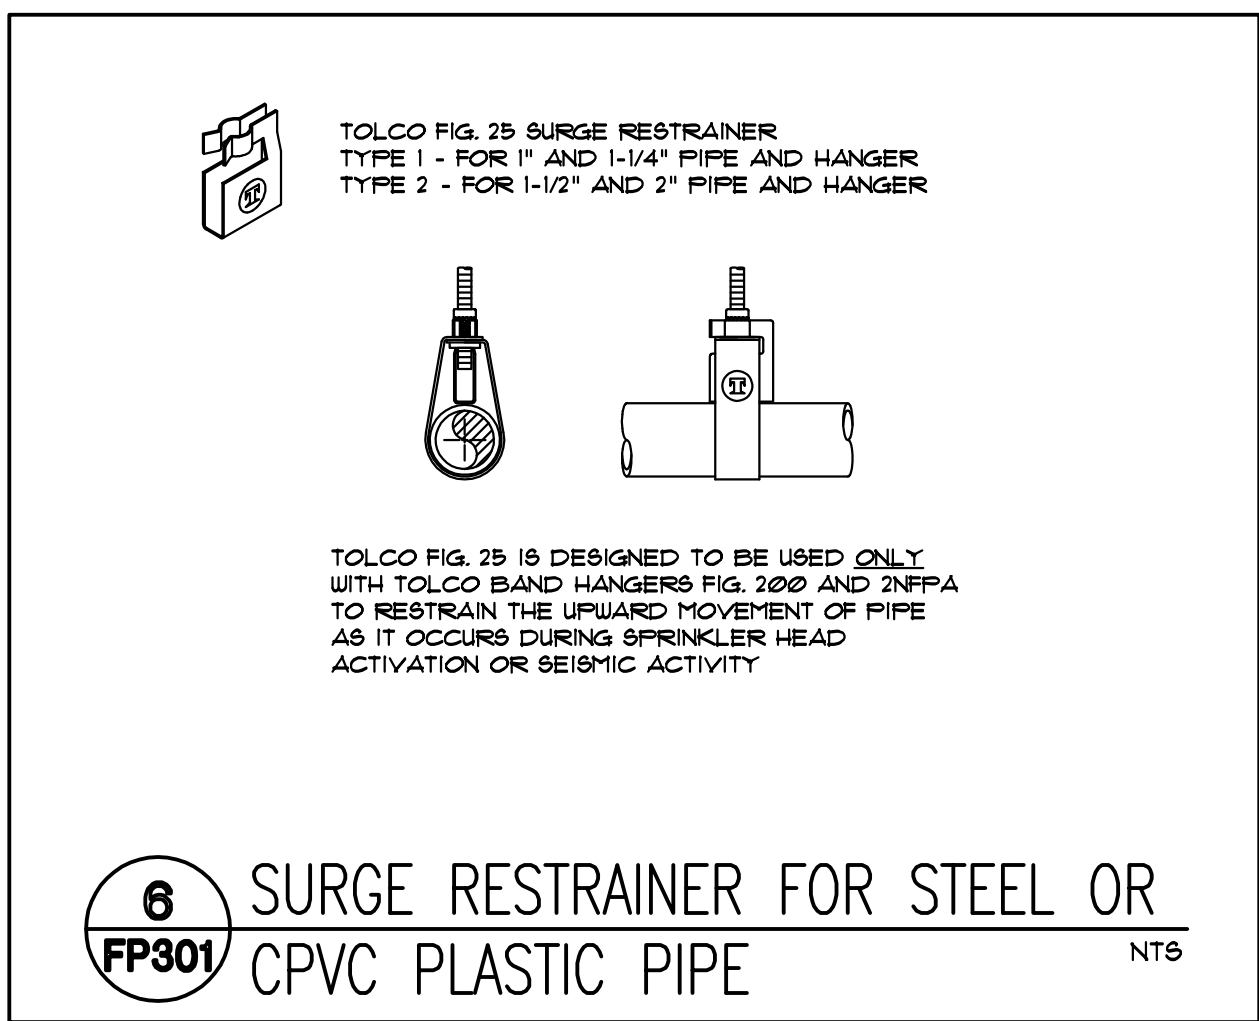
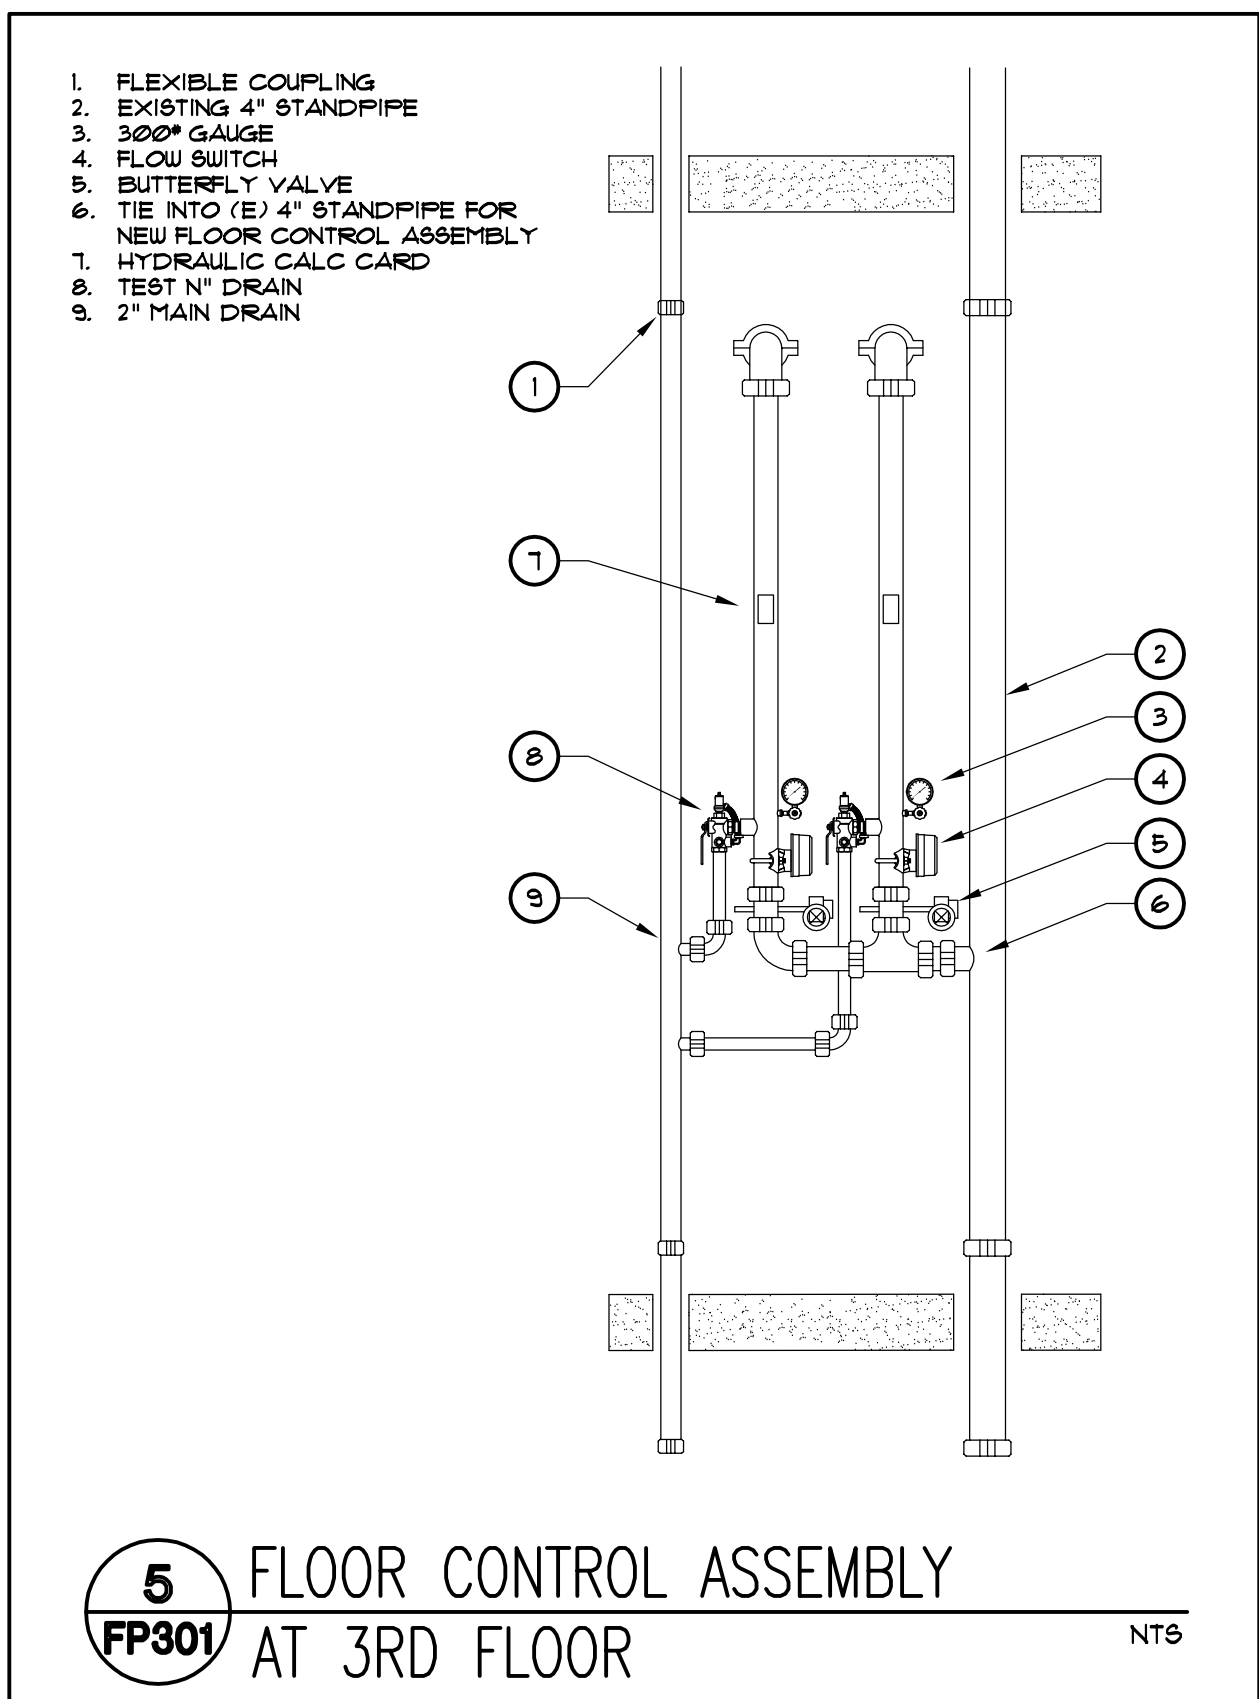
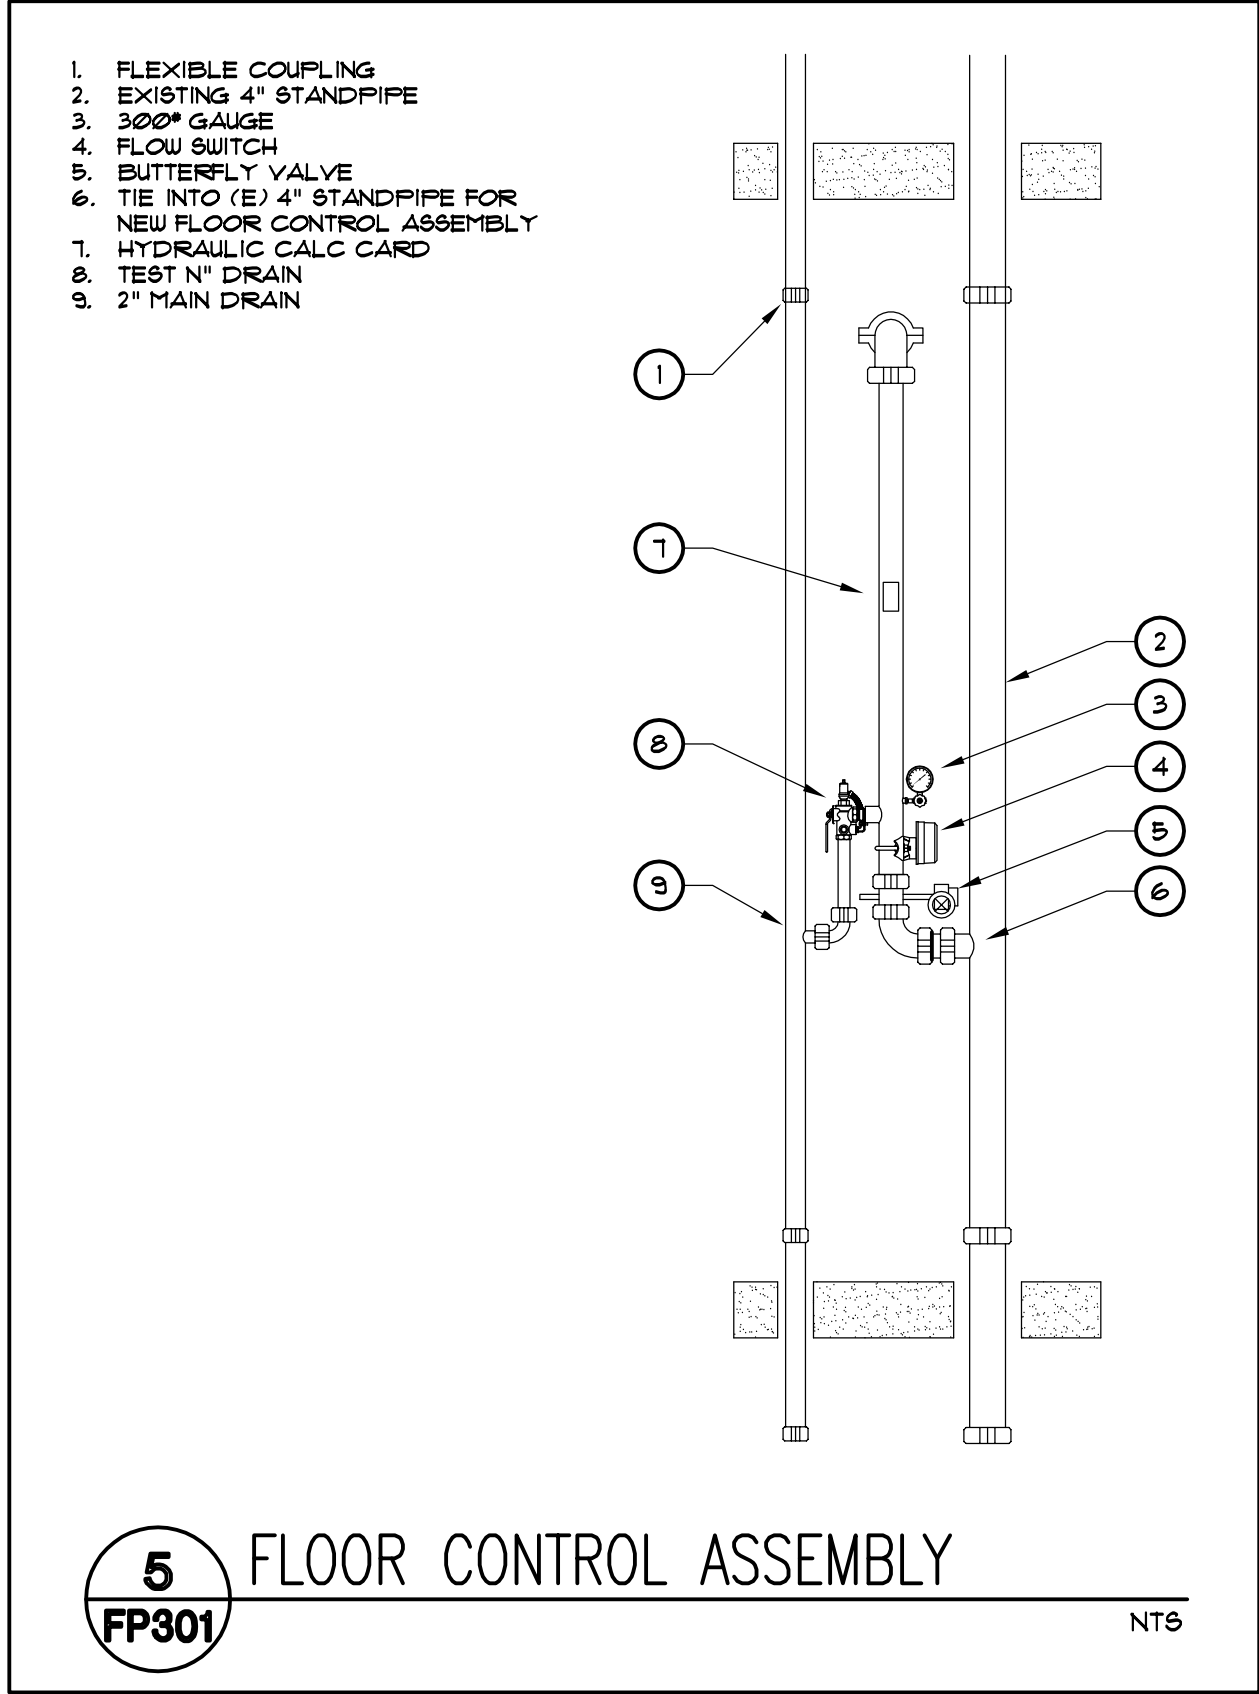
three inches = one foot  
one and one half inches = one foot  
one inch = one foot  
three quarters inch = one foot  
one half inch = one foot  
three eighths inch = one foot  
one quarter inch = one foot  
one eighth inch = one foot



HANGER RODS TO BE INSTALLED TIGHT TO PIPE TO PREVENT UPWARD MOVEMENT.

MAXIMUM DISTANCE BETWEEN HANGERS											
NOMINAL PIPE SIZE (in.)	3/4"	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	3-1/2"	4"	5"	6"
STEEL PIPE EXCEPT THREADED LIGHTWALL	N/A	12'-0"	12'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"
THREADED LIGHTWALL STEEL PIPE	N/A	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	N/A	N/A	N/A	N/A

HANGER ROD SIZES											
NOMINAL PIPE SIZE (in.)	3/4"	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	3-1/2"	4"	5"	6"
STEEL PIPE EXCEPT THREADED LIGHTWALL	N/A	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	1/2"	1/2"
THREADED LIGHTWALL STEEL PIPE	N/A	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	N/A	N/A

**7** HANGER CHART  
FP301 NTS



Revisions	Date	CONSULTANTS:  LP Consulting Engineers, Inc. 895 W. Ashlan Ave, Suite 101 Clovis, CA 93612 p. 559-346-2130 • f. 559-346-2131 www.lpengr.com Job #: 10-1096	ARCHITECT/ENGINEERS:  HMC Architects 1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720 T. 559.322.2444 / www.hmcarchitects.com	Drawing Title FIRE SPRINKLER DETAILS	Project Title BUILDING 24 SEISMIC CORRECTION AND ADDITION	Project Number 570-215 Building Number 24 Drawing Number FP301 Dwg. 128 of 180	Office of Construction and Facilities Management Department of Veterans Affairs
Approved Project Director		Date March 12, 2013		Checked SA	Drawn ES		